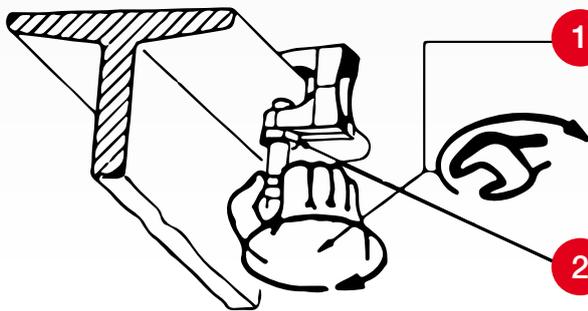
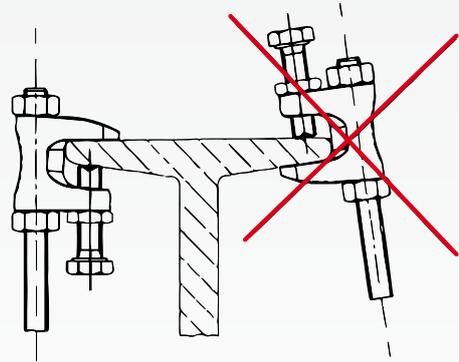


Trägerklammer Beam Clamp

Korrekte Installation an Trägern mit schrägen Schenkeln.

Correct installation to sections with tapered flanges.

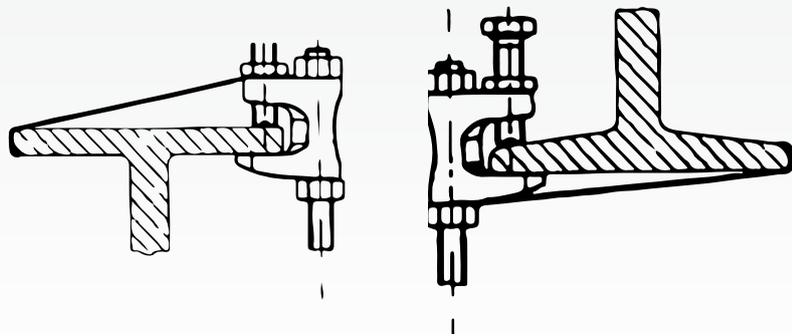

1

Andrehen von Hand + 1/2 Schlüsselumdrehung.
Tighten by hand + 1/2 turn with spanner.

2

Andrehen von Hand + 1/8 Schlüsselumdrehung.
Tighten by hand + 1/8 turn with spanner.

Sicherungslasche Safety strap



Trägerklammern können grundsätzlich mit einer Sicherungslasche gesichert werden. Die Vorschriften der zuständigen Behörden sind zu beachten. Bei Sprinkleranlagen nach VdS-Vorschriften müssen Trägerklammern für Rohre größer DN 65 gegen seitliches Abgleiten vom Träger gesichert werden. Bei Sprinkleranlagen nach FM-Vorschriften und nach UL-Vorschriften 203 dürfen Trägerklammern für Gewindestangen M16 und 5/8" nur in Zugrichtung gegen den Steg montiert werden. Bei UL 203 gilt dies auch für die BC12.

Beam Clamps can generally be secured by safety straps. The instructions of the certifying bodies have to be followed. According to VdS-regulations Beam Clamps must be secured when using Beam Clamps for pipes larger DN 65 to avoid slipping off Beam. According to FM-regulations and according to UL-regulation 203 Beam Clamps for threaded rods M16 and 5/8" can only be installed load direction set screw on load side (Top mount configuration only). According to UL 203 this rule applies also for Beam Clamps BC12.