



Flextronic -liitettävyysopas



- FIN Liitettävyysopas**
Asennus- ja käyttöohje
- Flamconnect -terminaali
 - Analogiset lähdöt
 - Digitaaliset (erilliset) lähdöt
 - Taloautomaatiojärjestelmän (BMS) käytöliittymä

Sisällysluettelo

1.	Asianmukainen käyttö	2
2.	Tuotekuvaus	2
2.2	Flamconnect - terminaali	3
2.3	Taloautomaatiojärjestelmän (BMS) liitintä Modbus- ja Bacnet-protokollalla	4
2.4	Toisiinsa liitetty Flamco-automaatit	4
2.5	Analogiset lähtösignaalit (asiakas)	4
2.6	Digitaaliset (erilliset) lähtösignaalit.....	5
3.	Langaton kokoonpano ja asetukset.....	5
3.1	Viestintärajapinnan asetukset	6
3.2	Digitaalisen (erillisen) lähdön ohjelmoiminen	6
4.	Modbus-kartoitustaulukko	7
4.1	Flamcomat.....	7
4.2	FlexFiller	9
5.	Bacnet-kartoitustaulukko.....	12
5.1	Flamcomat.....	12
5.2	FlexFiller	14

Tämä asiakirja on tarkoitettu liitteeksi tuotteen asennus- ja käyttöohjeeseen.
Tämä ohje tukee erityisesti Flamcomat G4 -laitteen turvallisesta käytöä.

Lisää asennusohjeita ja tähän laitteeseen liittyviä asiakirjoja eri kielillä löydät osoitteesta www.flamcogroup.com/manuals. Tarkempia tuotekohtaisia tietoja voi pyytää lähimästä Flamco-toimipisteestä.

Selite:

-  Koti
-  Asetukset
-  Yleinen
-  Huoltotiedot

1. Asianmukainen käyttö

Flextronic-ohjainyksikköä on käytettävä tämän käyttöohjeen mukaisesti. Alkuperäisen asiakirjan vaatimustenmukaisuusvakuutus on edelleen voimassa.

2. Tuotekuvaus


Flextronic on Flamco-automaattien yleinen ohjainyksikkö.

Se sisältää laajan valikoiman viestintävaihtoehtoja, jotka voidaan aktivoida Flextronic-lisävarusteet-valikossa:

1. Ethernet-liitäntä taloautomaatiojärjestelmän (BMS) yhdistämiseksi Modbus- tai Bacnet-protokollaa käyttäen.
2. USB-liitäntä toimintalokin tallennukseen tai laiteohjelmiston päivitykseen.
3. CAN-väylälitiännät (pariksi ketjutukseen) usean Flamco-automaatin yhteenliittämistä varten.
4. RS-485-liitännät (pariksi ketjutukseen) Flamco Remote Service -yhdyskäytävän liitäntään (Flamconnect) tai vaihtoehtoisesti taloautomaatiojärjestelmän (BMS) yhdistämiseen Modbus- tai Bacnet-protokollan kautta.
5. Langaton käytöliittymä (2 400...2 485 GHz) pariliitoksen muodostamiseen älypuhelimen tai tabletin kanssa.
6. Analogisten lähtösignaalien jännite säiliön täytyöasteen kaukonäyttöä ja järjestelmän painetta varten (0–10 V).
7. Digitaaliset (erilliset) lähtösignaalit (250 V AC, 5 A kork., jännitteeton). Mukautetut virheet ja varoitukset voidaan määrittää kolmeen liitäntään Flextronic-hälytykset-valikossa.

Määrittämättömät liitännät on tarkoitettu automaattien lisävarusteille tai muita toimintatarkoituksia varten. Niitä ei käytetä asiakasrajapintaan tai viestintään.


2.1 Johdotustiedot

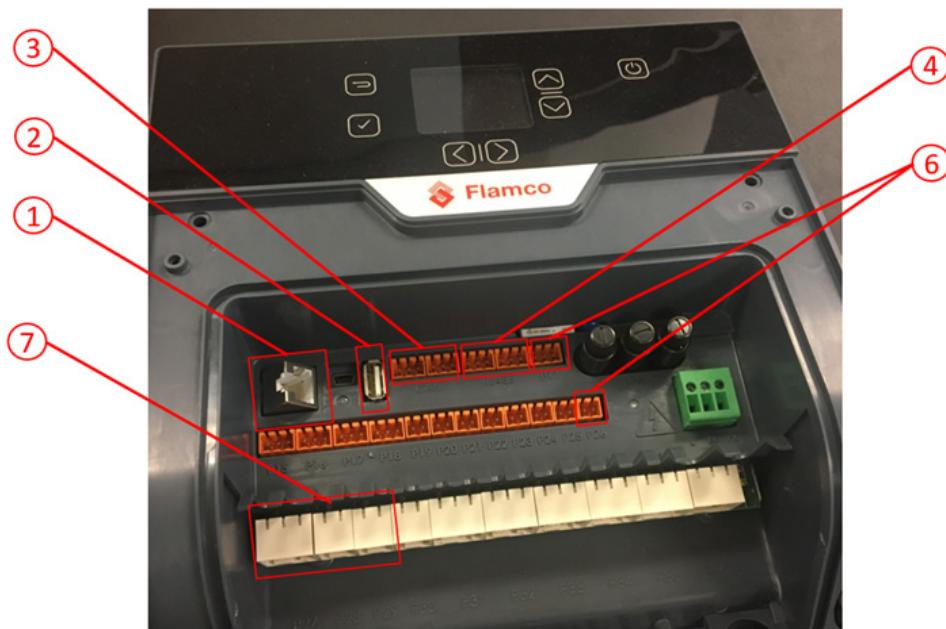


Asennuksen, tietojen käsittelyn ja käyttöönnoton saa suorittaa vain tehtävään koulutettu ja pätevä henkilöstö. Asianmukaisia kansallisia standardeja, määräyksiä ja sääntöjä on noudatettava. Lisää asennusohjeita ja tähän laitteeseen liittyviä asiakirjoja eri kielillä löydät osoitteesta www.flamcogroup.com/manuals.

- Lisäkaapelit eivät sisällä toimitukseen eikä Flamco toimita niitä erikseen.
- Flamco suosittelee kierrettyä suojaattua parikaapelia.
- Päätevastus on 120 ohmia.
- Kaapeleiden suurin sallittu pituus on 500 m.

2.2 Flamconnect - terminaali

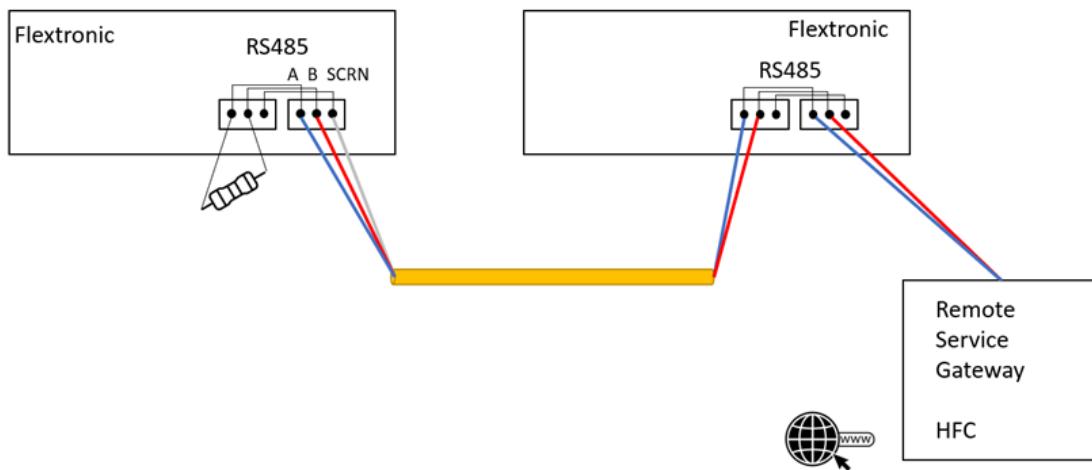


2.3 Taloautomaatiojärjestelmän (BMS) liitäntä Modbus- ja Bacnet-protokollalla

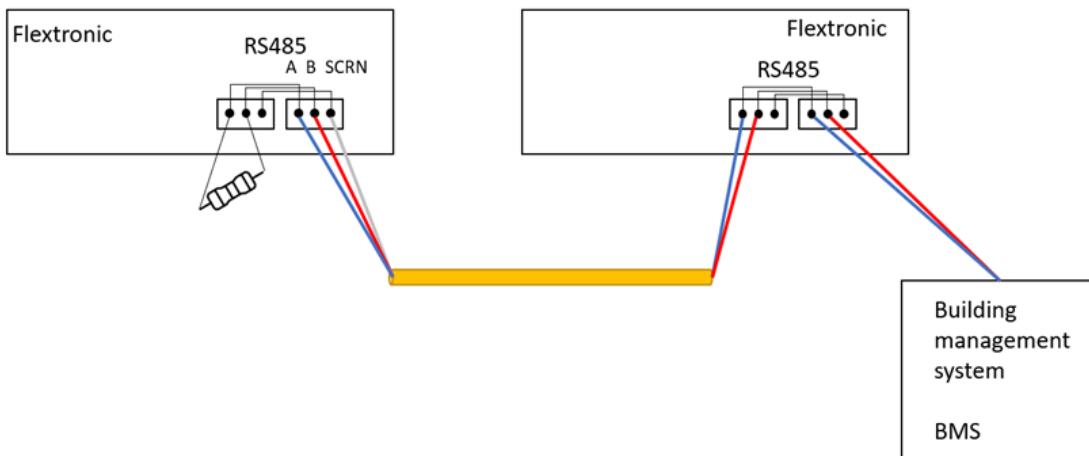

Samanaikainen viestintä sekä Modbus- että Bacnet-protokollalla ei ole mahdollista RS-485-väylällä.
Jos kumpaanakin protokollaa tarvitaan, toista protokollaa on käytettävä Ethernet-yhteydellä (IP).


Käytettäessä Flamconnect Remote Service -yhdyskäytävää RS485-liitäntä on tarkoitettu tälle ominaisuudelle.
Jos myös Modbus- tai Bacnet-protokollaa tarvitaan, se voidaan saada toimimaan vain Ethernet-yhteydellä (IP).

2.4 Toisiinsa liitettyt Flamco-automaatit



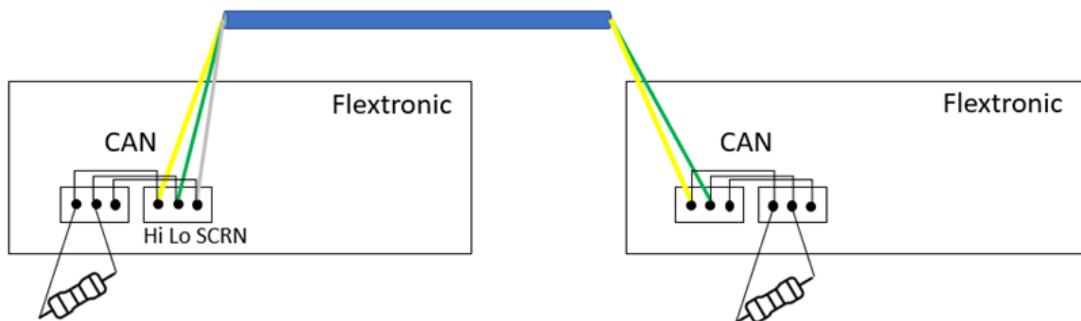


2.5 Analogiset lähtösignaalit (asiakas)

Näyttää järjestelmän paineen ja säiliön täyttöasteen analogisen jännitesignaalin.

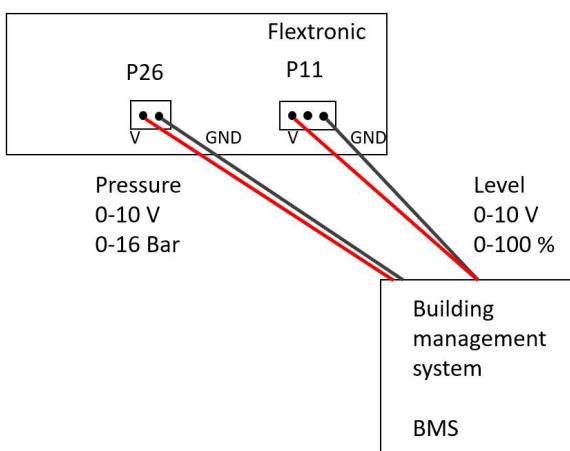

2.6 Digitaaliset (erilliset) lähtösignaalit

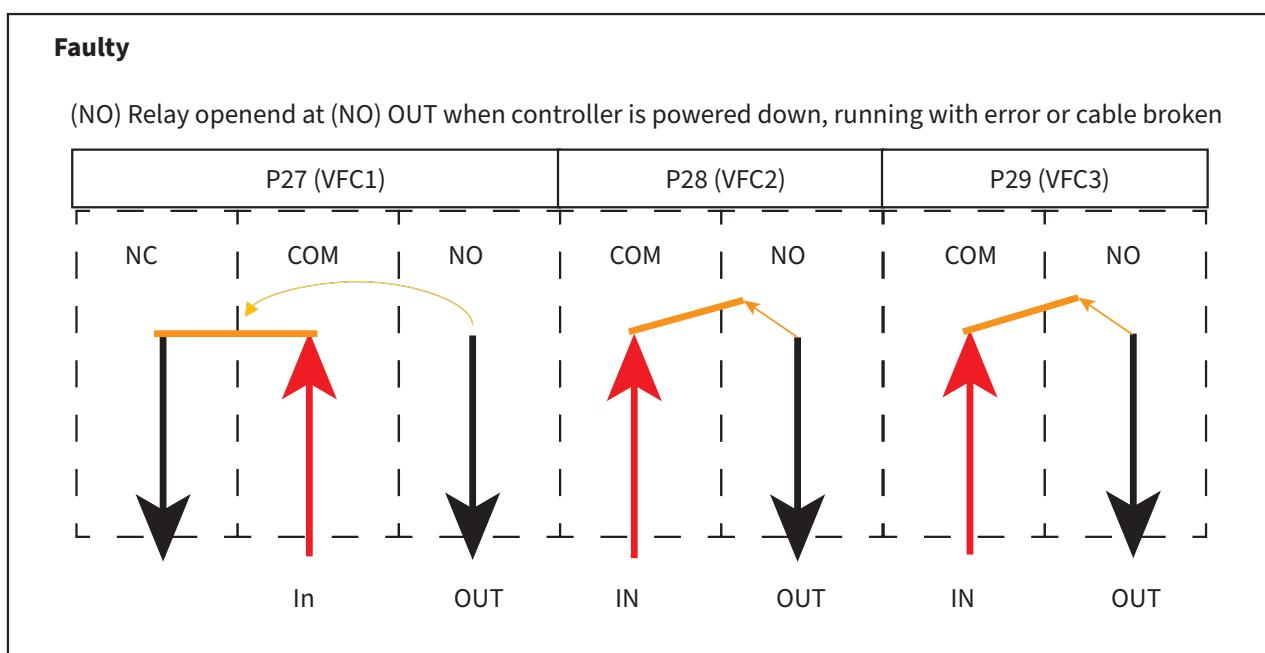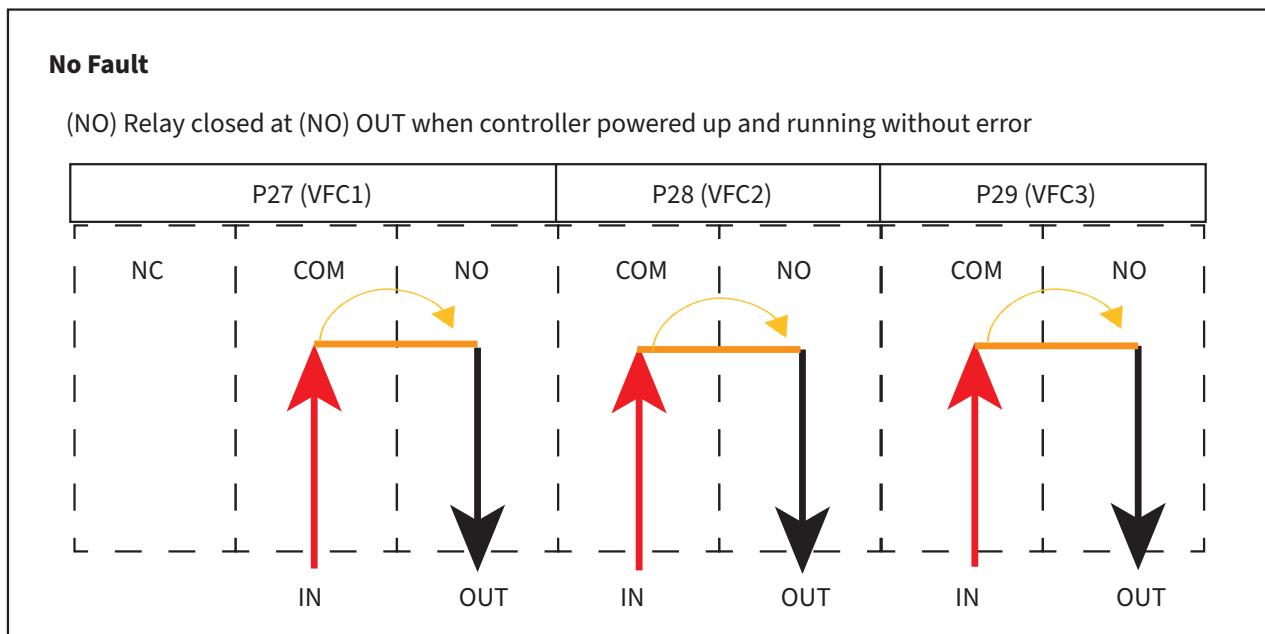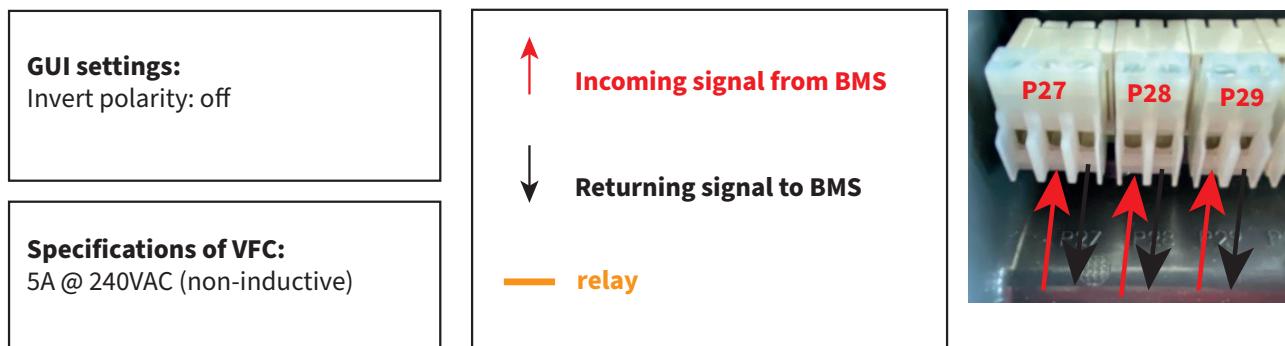

Näyttää automaatin tilan. Virheilmoitus voidaan määrittää jokaiseen lähtöön.
P29-lähtö on lämmityskattilan > 110 °C:n tilan lukitussignaali, jota ei voi käyttää hälyttämiseen tässä tilassa.

3. Langaton kokoonpano ja asetukset

Kokoontapanon määritys voidaan tehdä Flamconnect-sovelluksella.

Anna salasana pariliitokseen muodostamista varten. Se löytyy automaatin QR-kooditarrasta tai näytöltä.



	Järjestelmätiedot	Näyttää automaatin ja ohjaimen tiedot.	 
--	-------------------	--	--

Asiakasrajapintojen ja viestintäprotokollien määritys on käytettävissä ohjaimen valikossa.

	Lisäosat	Aktivoi automaatin lisäohjaimet.	 
---	----------	----------------------------------	---

3.1 Viestintärajapinnan asetukset

Ethernet:

IP-osoite 192.168.100.150
IP-maski 255.255.255.0
IP-yhdyskäytävä 192.168.100.1

RS-485:

Flextronic on toissijainen yksikkö.

Laitetunnus valittavissa
Siirtonopeus 19200
Pariteetti 8-n-1

 Samalle käyttöliittymälle voidaan määrittää vain yksi protokolla kerrallaan. Jos Remote Service -yhdyskäytävä liitetään, Modbus- ja Bacnet-protokollia ei voi käyttää RS-485-välän kautta. Tämän sijaan taloautomatiointijärjestelmän (BMS) yhdistämiseen on käytettävä Ethernet-liitintä.

3.2 Digitaalisen (erillisen) lähdön ohjelmoiminen

Mukautetut virheet (virheet ja varoitukset) on mahdollista määrittää jännitteettömille digitaalisille (erillisille) lähdöille. Jos samaan lähtöön määritetään enemmän kuin yksi virhe, lähtö aktivoituu, jos jokin määritetyistä virheistä on aktiivinen tässä lähdössä.

Virheiden määrittäminen on käytettävissä Flextronic-valikossa:

	Hälytykset	Aava valikon, jossa voidaan määrittää hälytysviestit asiaankuuluville jännitteettömille lähdöille.	    
--	------------	--	---

4. Modbus-kartoitustaulukko

4.1 Flamcomat

Register	Access	Name	Type	Unit	Range
0x0001	R	Current working pressure	UINT16	cbar	0..16000
0x0002	R	Current vessel level	UINT16	%	0...100
0x0003	R	Outputs state (1-on)	UINT16		Bit 0: P35 M1 Active (pump/compressor) Bit 1: P36 M2 Active (pump/compressor) Bit 2: P33 V1 active (Valve 1) Bit 3: P34 V2 active (Valve 2) Bit 4: P31 V3 Active (Valve 3/ Refill pump) Bit 8: Degassing On (Enabled)* Bit 9: Degassing mode (0-normal, 1-turbo)*
0x0004	R	Error table 1 1-error active)	UINT16		Bit 0: Single pump/ compressor maximum run time error Bit 1: Redundant pumps/ compressor maximum run time error Bit 2: Load dependant pumps/ compressor maximum run time error Bit 3: Single pump/ compressor current error Bit 4: Pump A current error (double pump/ compressor configuration) Bit 5: Pump B current error (doublepump/ compressor configuration) Bit 6: Pumps A and B current error (double pump/ compressor configuration) Bit 7: Pump C/ compressor current error Bit 8: Self-learning valve correction error Bit 9: Self-learning pump correction error Bit 10: Pressure sensor current exceeded Bit 11: Pressure sensor no current Bit 12: Load cell current exceeded Bit 13: Load cell no current Bit 14: Pump A/ compressor power consumption too high Bit 15: Pump B/ compressor power consumption too high
0x0005	R	Error table 2 1-error active)	UINT16		Bit 0: Pump C power consumption too high Bit 1: Maximum Runtime P35 M1 exceeded Bit 2: Maximum Runtime P36 M2 exceeded Bit 3: Maximum supplantation threaded water amount exceeded Bit 4: Pump running, no decrease of water level in vessel* Bit 5: Valve open, no increase of water level in vessel* Bit 6: Maximum runtime P33 V1 exceeded Bit 7: Maximum runtime P34 V2 exceeded Bit 8: To run quick fill* Bit 9: To run system fill* Bit 10: System run in auto mode Bit 11: Quick system filling active, V to stop* Bit 12: System filling active, V to stop* Bit 13: Manual mode active, press V to start automat Bit 14: Diaphragm rupture Bit 15: Spare

Register	Access	Name	Type	Unit	Range
0x0006	R	Error table 3 (1-error active)	UINT16		Bit 0: Water level increase in vessel without Flamcomat activity* Bit 1: Water level decrease in vessel without Flamcomat activity* Bit 2: Maintenance 1 is due Bit 3: Initial fill failed Bit 4: Maximum refill time exceeded Bit 5: Maximum drain time exceeded* Bit 6: No refill flow Bit 7: Amount refill water too much Bit 8: Spare Bit 9: Spare Bit 10: Spare Bit 11: Initial fill active Bit 12: Manual initial fill active Bit 13: System fill timer expired Bit 14: Quick fill timer expired* Bit 15: Maintenance 2 is due
0x0007	R	Error table 4 (1-error active)	UINT16		Bit 0: Maintenance 3 is due Bit 1: Maintenance 4 is due Bit 2: Spare Bit 3: Spare Bit 4: Spare Bit 5: Spare Bit 6: Spare Bit 7: Spare Bit 8: Spare Bit 9: Spare Bit 10: Spare Bit 11: Spare Bit 12: Spare Bit 13: Spare Bit 14: Spare Bit 15: Spare
0x0008	R	Operational hours total	UINT16	hours	
0x0009	R	Availability (0 - No, 1 - Yes)	UINT16		Bit 0: P35 M1 pressure increase Bit 1: P36 M2 Pressure increase Bit 2: P33 V1 (pressure decrease/ compressor valve) Bit 3: P34 V2 (pressure decrease/ compressor valve) Bit 4: P31 V3 (filling pump/ valve) Bit 8: Minimum pressure limiter Bit 9: Diaphragm rupture sensor Bit 10: Maximum temperature sensor
0x000A	R	Pressure setpoint	UINT16	cbar	0..16000
0x000B	R	Minimum water level (absolute)	UINT16	%	
0x000C	R	Level refeeding On (absolute)	UINT16	%	
0x000D	R	Level refeeding Off (absolute)	UINT16	%	
0x000E	R	Minimum level alarm limit	UINT16	%	
0x000F	R	Maximum level alarm limit	UINT16	%	
0x0010	R	Nominal volume of vessel	UINT16	l	
0x0011	R	Operational mode	UINT16		0 - single mode, 1 - redundant mode 2 - load-dependent
0x0012	R	Total refill liters	UINT16	l	
0x0013	R	Total refill minutes	UINT16	minute	

* Not applicable for the Flamcomat MK-U G4

4.2 FlexFiller

Register	Access	Name	Type	Unit	Formatting
0x0000	R	SystemPressure	U16	mbar	Decimal
0x0001	R	SupplyPressure	U16	mbar	Decimal
0x0002	R	TankLevel	U16	%	Decimal
0x0003	R	VacuumPressure	U16	mbar	Decimal
0x000A	R	PressureSetpoint	U16	mbar	Decimal
0x000B	R	SafetyValveSetting	U16	mbar	Decimal
0x000C	R	Calculated_LowPressureAlarm	U16	mbar	Decimal
0x000D	R	Calculated_HighPressureAlarm	U16	mbar	Decimal
0x000E	R	VesselVolume	U16	l	Decimal
0x0030	R	DigitalInput	U16	Binary	NA
0x0031	R	DigitalOutput	U16	Binary	Bit 0: P36 (Pump 2 / NC) Bit 1: P35 (Pump 1 / Direct drain valve) Bit 2: P34 (NC) Bit 3: P33 (NC) Bit 4: P32 (NC) Bit 5: P31 (Refill / Inlet valve) Bit 6: P29 (VFC 1) Bit 7: P28 (VFC 2) Bit 8: P27 (VFC 3)
0x0032	R	AccessoryPresenceMask	U16	Binary	NA
0x0033	R	AccessoryPresenceMask	U16	Binary	NA
0x0034	R	DaysToTheNextMaintenance1	U16	count	Decimal
0x0035	R	DaysToTheNextMaintenance2	U16	count	Decimal
0x0036	R	DaysToTheNextMaintenance3	U16	count	Decimal
0x0037	R	DaysToTheNextMaintenance4	U16	count	Decimal
0x0040	R	Errors_3	U16	Binary	NA (For Future Use)
0x0041	R	Errors_2	U16	Binary	NA (For Future Use)
0x0042	R	Errors_1	U16	Binary	NA (For Future Use)
0x0043	R	Errors_0	U16	Binary	Bit 0: ALR_SYSTEM_PRESSURE_LOW Bit 1: ALR_SYSTEM_PRESSURE_BELOW_MINIMUM Bit 2: ALR_SYSTEM_PRESSURE_SENSOR_OOB_LOW Bit 3: ALR_SYSTEM_PRESSURE_SENSOR_OOB_HIGH Bit 4: ALR_SYSTEM_PRESSURE_HIGH Bit 5: ALR_SYSTEM_FILL_TIMER_EXPIRED Bit 6: ALR_SAFETY_VALVE_ACTIVE Bit 7: ALR_VESSEL_PRECHARGE_LOST Bit 8: ALR_PUMP_1_OVER_CURRENT Bit 9: ALR_PUMP_2_OVER_CURRENT Bit 10: ALR_PUMP_1_NO_CURRENT Bit 11: ALR_PUMP_2_NO_CURRENT
0x0044	R	Warnings_0	U16	Binary	NA (For Future Use)
0x0045	R	Warnings_1	U16	Binary	Bit 0: WRN_SYPHON_FLUSH_DETECTED

0x0046	R	Warnings_2	U16	Binary	Bit 0: WRN_SYSTEM_FILL_ACTIVE Bit 1: WRN_SYSTEM_FILL_ON_HOLD Bit 2: WRN_ANTI_LEGIONELLA_RUNNING Bit 3: WRN_DEVICE_REBOOT Bit 4: WRN_TANK_LEVEL_SENSOR_OOB_LOW Bit 5: WRN_TANK_LEVEL_SENSOR_OOB_HIGH Bit 6: WRN_PUMP_DRY_RUN Bit 7: WRN_TANK_OVERFLOW Bit 8: WRN_MANUAL_SYSTEM_FILL Bit 9: WRN_PUMP_1_RUNTIME Bit 10: WRN_PUMP_2_RUNTIME Bit 11: WRN_ANTI_LEGIONELLA_RECOVERY Bit 12: WRN_VACUUM_PRESSURE_SENSOR_OOB_LOW Bit 13: WRN_VACUUM_PRESSURE_SENSOR_OOB_HIGH Bit 14: WRN_FILTER_FULL Bit 15: WRN_VACUUM_ERROR
0x0047	R	Warnings_3	U16	Binary	Bit 0: WRN_SYSTEM_PRESSURE_HIGH Bit 1: WRN_MAX_AMOUNT_TOPUP_WATER Bit 2: WRN_SYSTEM_PRESSURE_LOW Bit 3: WRN_NUMBER_OF_TOPUPS Bit 4: WRN_SUPPLY_PRESSURE_TOO_LOW Bit 5: WRN_SUPPLY_PRESSURE_TOO_HIGH Bit 6: WRN_SUPPLY_PRESSURE_SENSOR_OOB_LOW Bit 7: WRN_SUPPLY_PRESSURE_SENSOR_OOB_HIGH Bit 8: WRN_SYSTEM_FILL_SELF_LEARNING Bit 9: WRN_MANUAL_MODE Bit 10: WRN_MAXIMUM_TOPUP_TIME_EXCEEDED Bit 11: WRN_NO_TOPUP_FLOW Bit 12: WRN_MAINTENANCE_1_DUE Bit 13: WRN_MAINTENANCE_2_DUE Bit 14: WRN_MAINTENANCE_3_DUE Bit 15: WRN_MAINTENANCE_4_DUE
0x0050	R	OverallRuntime_H	U16	h	Decimal (Combine 0x0050&0x0051 to read the full U32 value)
0x0051	R	OverallRuntime_L	U16	h	Decimal (Combine 0x0050&0x0051 to read the full U32 value)
0x0052	R	TotalFilledVolume_H	U16	ml	Decimal (Combine 0x0052&0x0053 to read the full U32 value)
0x0053	R	TotalFilledVolume_L	U16	ml	Decimal (Combine 0x0052&0x0053 to read the full U32 value)
0x0054	R	TotalFillTime_H	U16	s	Decimal (Combine 0x0054&0x0055 to read the full U32 value)
0x0055	R	TotalFillTime_L	U16	s	Decimal (Combine 0x0054&0x0055 to read the full U32 value)
0x0056	R	ActivationsMv1_H	U16	count	Decimal (Combine 0x0056&0x0057 to read the full U32 value)
0x0057	R	ActivationsMv1_L	U16	count	Decimal (Combine 0x0056&0x0057 to read the full U32 value)
0x0058	R	ActivationsMv2_H	U16	count	Decimal (Combine 0x0058&0x0059 to read the full U32 value)
0x0059	R	ActivationsMv2_L	U16	count	Decimal (Combine 0x0058&0x0059 to read the full U32 value)
0x005A	R	RuntimeMv1_H	U16	s	Decimal (Combine 0x005A&0x005B to read the full U32 value)
0x005B	R	RuntimeMv1_L	U16	s	Decimal (Combine 0x005A&0x005B to read the full U32 value)
0x005C	R	RuntimeMv2_H	U16	s	Decimal (Combine 0x005C&0x005D to read the full U32 value)
0x005D	R	RuntimeMv2_L	U16	s	Decimal (Combine 0x005C&0x005D to read the full U32 value)
0x005E	R	ActivationsPump1_H	U16	count	Decimal (Combine 0x005E&0x005F to read the full U32 value)
0x005F	R	ActivationsPump1_L	U16	count	Decimal (Combine 0x005E&0x005F to read the full U32 value)
0x0060	R	ActivationsPump2_H	U16	count	Decimal (Combine 0x0060&0x0061 to read the full U32 value)
0x0061	R	ActivationsPump2_L	U16	count	Decimal (Combine 0x0060&0x0061 to read the full U32 value)
0x0062	R	ActivationsValve1_H	U16	count	Decimal (Combine 0x0062&0x0063 to read the full U32 value)
0x0063	R	ActivationsValve1_L	U16	count	Decimal (Combine 0x0062&0x0063 to read the full U32 value)
0x0064	R	RuntimePump1_H	U16	s	Decimal (Combine 0x0064&0x0065 to read the full U32 value)
0x0065	R	RuntimePump1_L	U16	s	Decimal (Combine 0x0064&0x0065 to read the full U32 value)

0x0066	R	RuntimePump2_H	U16	s	Decimal (Combine 0x0066&0x0067 to read the full U32 value)
0x0067	R	RuntimePump2_L	U16	s	Decimal (Combine 0x0066&0x0067 to read the full U32 value)
0x0068	R	RuntimeValve1_H	U16	s	Decimal (Combine 0x0068&0x0069 to read the full U32 value)
0x0069	R	RuntimeValve1_L	U16	s	Decimal (Combine 0x0068&0x0069 to read the full U32 value)
0x006A	R	NrOfNormalTopUps_H	U16	count	Decimal (Combine 0x006A&0x006B to read the full U32 value)
0x006B	R	NrOfNormalTopUps_L	U16	count	Decimal (Combine 0x006A&0x006B to read the full U32 value)
0x006C	R	NrOfEmergencyStops_H	U16	count	Decimal (Combine 0x006C&0x006D to read the full U32 value)
0x006D	R	NrOfEmergencyStops_L	U16	count	Decimal (Combine 0x006C&0x006D to read the full U32 value)
0x006E	R	SafetyValveActivations_H	U16	count	Decimal (Combine 0x006E&0x006F to read the full U32 value)
0x006F	R	SafetyValveActivations_L	U16	count	Decimal (Combine 0x006E&0x006F to read the full U32 value)
0x0070	R	ActivationsVfc1_H	U16	count	Decimal (Combine 0x0070&0x0071 to read the full U32 value)
0x0071	R	ActivationsVfc1_L	U16	count	Decimal (Combine 0x0070&0x0071 to read the full U32 value)
0x0072	R	ActivationsVfc2_H	U16	count	Decimal (Combine 0x0072&0x0073 to read the full U32 value)
0x0073	R	ActivationsVfc2_L	U16	count	Decimal (Combine 0x0072&0x0073 to read the full U32 value)
0x0074	R	ActivationsVfc3_H	U16	count	Decimal (Combine 0x0074&0x0075 to read the full U32 value)
0x0075	R	ActivationsVfc3_L	U16	count	Decimal (Combine 0x0074&0x0075 to read the full U32 value)

5. Bacnet-kartoitustaulukko

5.1 Flamcomat

Object identifier	Access	Object Name	Type	Unit	Range
OBJECT_ANALOG_VALUE:0	R	Current working pressure	UINT16	cbar	0..16000
OBJECT_ANALOG_VALUE:1	R	Current vessel level	UINT16	%	0...100
OBJECT_ANALOG_VALUE:2	R	Outputs state (1-on)	UINT16		Bit 0: P35 M1 active (pump/ compressor) Bit 1: P36 M2 active (pump/ compressor) Bit 2: P33 V1 active (valve 1) Bit 3: P34 V2 active (valve 2) Bit 4: P31 V3 active (valve 3) Bit 8: Degassing On (Enabled)* Bit 9: Degassing mode (0-normal, 1-turbo)*
OBJECT_ANALOG_VALUE:3	R	Error table 1 (1-error active)	UINT16		Bit 0: Single pump/ compressor maximum run time error Bit 1: Redundant pumps/ compressor maximum run time error Bit 2: Load dependent pumps/ compressor maximum run time error Bit 3: Single pump/compressor current error Bit 4: Pump A current error (double pump/ compressor configuration) Bit 5: Pump B current error (double pump/ compressor configuration) Bit 6: Pumps A and B/ compressor current error (double pump c configuration) Bit 7: Pump C/ compressor current error Bit 8: Self-learning valve correction error Bit 9: Self-learning pump/ compressor correction error Bit 10: Pressure sensor current exceeded Bit 11: Pressure sensor no current Bit 12: Load cell current exceeded Bit 13: Load cell no current Bit 14: Pump A/ compressor power consumption too high Bit 15: Pump B/ compressor power consumption too high
OBJECT_ANALOG_VALUE:4	R	Error table 2 (1-error active)	UINT16		Bit 0: Pump C/ compressor power consumption too high Bit 1: Maximum runtime P35 M1 exceeded Bit 2: Maximum runtime P36 M2 exceeded Bit 3: Maximum supplantation threaded water amount exceeded Bit 4: Pump/ compressor running, no decrease of water level in vessel Bit 5: Valve open, no increase of water level in vessel Bit 6: Maximum runtime P33 V1 exceeded Bit 7: Maximum runtime P34 V2 exceeded Bit 8: To run quick fill* Bit 9: To run system fill* Bit 10: System run in auto mode Bit 11: Quick system filling active, V to stop* Bit 12: System filling active, V to stop* Bit 13: Manual mode active, press V to start automat Bit 14: Diaphragm rupture Bit 15: Spare

Object identifier	Access	Object Name	Type	Unit	Range
OBJECT_ANALOG_VALUE:5	R	Error table 3 (1-error active)	UINT16		Bit 0: Water level increase in vessel without Flamcomat activity* Bit 1: Water level decrease in vessel without Flamcomat activity* Bit 2: Maintenance 1 is due Bit 3: Initial fill failed Bit 4: Maximum refill time exceeded Bit 5: Maximum drain time exceeded* Bit 6: No refill flow Bit 7: Amount refill water too much Bit 8: Spare Bit 9: Spare Bit 10: Spare Bit 11: Initial fill active Bit 12: Manual initial fill active Bit 13: System fill timer expired* Bit 14: Quick fill timer expired* Bit 15: Maintenance 2 is due
OBJECT_ANALOG_VALUE:6	R	Error table 4 (1-error active)	UINT16		Bit 0: Maintenance 3 is due Bit 1: Maintenance 4 is due Bit 2: Spare Bit 3: Spare Bit 4: Spare Bit 5: Spare Bit 6: Spare Bit 7: Spare Bit 8: Spare Bit 9: Spare Bit 10: Spare Bit 11: Spare Bit 12: Spare Bit 13: Spare Bit 14: Spare Bit 15: Spare
OBJECT_ANALOG_VALUE:7	R	Operational hours total	UINT16	hours	
OBJECT_ANALOG_VALUE:8	R	Availability (0 - No, 1 - Yes)	UINT16		Bit 0: P35 M1 pressure increase Bit 1: P36 M2 Pressure increase Bit 2: P33 V1 (pressure decrease/ compressor valve) Bit 3: P34 V2 (pressure decrease/ compressor valve) Bit 4: P31 V3 (filling pump/ valve) Bit 8: Minimum pressure limiter Bit 9: Diaphragm rupture sensor Bit 10: Maximum temperature sensor
OBJECT_ANALOG_VALUE:9	R	Pressure setpoint	UINT16	cbar	0..16000
OBJECT_ANALOG_VALUE:10	R	Minimum water level (absolute)	UINT16	%	
OBJECT_ANALOG_VALUE:11	R	Level refeeding On (absolute)	UINT16	%	
OBJECT_ANALOG_VALUE:12	R	Level refeeding Off (absolute)	UINT16	%	
OBJECT_ANALOG_VALUE:13	R	Minimum level alarm limit	UINT16	%	
OBJECT_ANALOG_VALUE:14	R	Maximum level alarm limit	UINT16	%	
OBJECT_ANALOG_VALUE:15	R	Nominal volume of vessel	UINT16	l	
OBJECT_ANALOG_VALUE:16	R	Operational mode	UINT16		0 - single mode, 1 - redundant mode 2 - load-dependent
OBJECT_ANALOG_VALUE:17	R	Total refill liters	UINT16	l	
OBJECT_ANALOG_VALUE:18	R	Total refill minutes	UINT16	minute	

* Not applicable for the Flamcomat MK-U G4

5.2 FlexFiller

Object ID	Access	Object name	Type	Unit	Formatting
OBJECT_ANALOG_VALUE:0	R	"alarms"	U64	Binary	Bit 0: ALR_SYSTEM_PRESSURE_LOW Bit 1: ALR_SYSTEM_PRESSURE_BELOW_MINIMUM Bit 2: ALR_SYSTEM_PRESSURE_BELOW_MINIMUM Bit 3: ALR_SYSTEM_PRESSURE_SENSOR_OOB_HIGH Bit 4: ALR_SYSTEM_PRESSURE_HIGH Bit 5: ALR_SYSTEM_FILL_TIMER_EXPIRED Bit 6: ALR_SAFETY_VALVE_ACTIVE Bit 7: ALR_VESSEL_PRECHARGE_LOST Bit 8: ALR_PUMP_1_OVER_CURRENT Bit 9: ALR_PUMP_2_OVER_CURRENT Bit 10: ALR_PUMP_1_NO_CURRENT Bit 11: ALR_PUMP_2_NO_CURRENT
OBJECT_ANALOG_VALUE:1	R	"warnings"	U64	Binary	Bit 0: WRN_SYSTEM_PRESSURE_HIGH Bit 1: WRN_MAX_AMOUNT_TOPUP_WATER Bit 2: WRN_SYSTEM_PRESSURE_LOW Bit 3: WRN_NUMBER_OF_TOPUPS Bit 4: WRN_SUPPLY_PRESSURE_TOO_LOW Bit 5: WRN_SUPPLY_PRESSURE_TOO_HIGH Bit 6: WRN_SUPPLY_PRESSURE_SENSOR_OOB_LOW Bit 7: WRN_SUPPLY_PRESSURE_SENSOR_OOB_HIGH Bit 8: WRN_SYSTEM_FILL_SELF_LEARNING Bit 9: WRN_MANUAL_MODE Bit 10: WRN_MAXIMUM_TOPUP_TIME_EXCEEDED Bit 11: WRN_NO_TOPUP_FLOW Bit 12: WRN_MAINTENANCE_1_DUE Bit 13: WRN_MAINTENANCE_2_DUE Bit 14: WRN_MAINTENANCE_3_DUE Bit 15: WRN_MAINTENANCE_4_DUE Bit 16: WRN_SYSTEM_FILL_ACTIVE Bit 17: WRN_SYSTEM_FILL_ON_HOLD Bit 18: WRN_ANTI_LEGIONELLA_RUNNING Bit 19: WRN_DEVICE_REBOOT Bit 20: WRN_TANK_LEVEL_SENSOR_OOB_LOW Bit 21: WRN_TANK_LEVEL_SENSOR_OOB_HIGH Bit 22: WRN_PUMP_DRY_RUN Bit 23: WRN_TANK_OVERFLOW Bit 24: WRN_MANUAL_SYSTEM_FILL Bit 25: WRN_PUMP_1_RUNTIME Bit 26: WRN_PUMP_2_RUNTIME Bit 27: WRN_ANTI_LEGIONELLA_RECOVERY Bit 28: WRN_VACUUM_PRESSURE_SENSOR_OOB_LOW Bit 29: WRN_VACUUM_PRESSURE_SENSOR_OOB_HIGH Bit 30: WRN_FILTER_FULL Bit 31: WRN_VACUUM_ERROR Bit 32: WRN_SYPHON_FLUSH_DETECTED
OBJECT_ANALOG_VALUE:2	R	"current system pressure"	U16	mbar	Decimal
OBJECT_ANALOG_VALUE:3	R	"current supply pressure"	U16	mbar	Decimal
OBJECT_ANALOG_VALUE:4	R	"current tank level"	U16	%	Decimal
OBJECT_ANALOG_VALUE:5	R	"current vacuum pressure"	U16	mbar	Decimal
OBJECT_ANALOG_VALUE:6	R	"pressure setpoint"	U16	mbar	Decimal
OBJECT_ANALOG_VALUE:7	R	"safety valve setting"	U16	mbar	Decimal
OBJECT_ANALOG_VALUE:8	R	"low pressure alarm limit"	U16	mbar	Decimal
OBJECT_ANALOG_VALUE:9	R	"high pressure alarm limit"	U16	mbar	Decimal
OBJECT_ANALOG_VALUE:10	R	"vessel volume"	U16	l	Decimal
OBJECT_ANALOG_VALUE:11	R	"digital input"	U16	Binary	NA

OBJECT_ANALOG_VALUE:12	R	"digital output"	U16	Binary	Bit 0: P36 (Pump 2 / NC) Bit 1: P35 (Pump 1/MV1 topup valve) Bit 2: P34 (NC) Bit 3: P33 (NC) Bit 4: P32 (NC) Bit 5: P31 (Inlet valve/MV2 Drain Valve) Bit 6: P29 (VFC 1) Bit 7: P28 (VFC 2) Bit 8: P27 (VFC 3)
OBJECT_ANALOG_VALUE:13	R	"accessories"	U32	Binary	NA
OBJECT_ANALOG_VALUE:14	R	"days to next maintenance 1"	U16	count	Decimal
OBJECT_ANALOG_VALUE:15	R	"days to next maintenance 2"	U16	count	Decimal
OBJECT_ANALOG_VALUE:16	R	"days to next maintenance 3"	U16	count	Decimal
OBJECT_ANALOG_VALUE:17	R	"days to next maintenance 4"	U16	count	Decimal
OBJECT_ANALOG_VALUE:18	R	"overall runtime"	U32	h	Decimal
OBJECT_ANALOG_VALUE:19	R	"total filled volume"	U32	ml	Decimal
OBJECT_ANALOG_VALUE:20	R	"total fill time"	U32	s	Decimal
OBJECT_ANALOG_VALUE:21	R	"activations MV1"	U32	count	Decimal
OBJECT_ANALOG_VALUE:22	R	"activations MV2"	U32	count	Decimal
OBJECT_ANALOG_VALUE:23	R	"runtime MV1"	U32	s	Decimal
OBJECT_ANALOG_VALUE:24	R	"runtime MV2"	U32	s	Decimal
OBJECT_ANALOG_VALUE:25	R	"activations Pump1"	U32	count	Decimal
OBJECT_ANALOG_VALUE:26	R	"activations Pump2"	U32	count	Decimal
OBJECT_ANALOG_VALUE:27	R	"activations Valve1"	U32	count	Decimal
OBJECT_ANALOG_VALUE:28	R	"runtime Pump1"	U32	s	Decimal
OBJECT_ANALOG_VALUE:29	R	"runtime Pump2"	U32	s	Decimal
OBJECT_ANALOG_VALUE:30	R	"runtime Valve1"	U32	s	Decimal
OBJECT_ANALOG_VALUE:31	R	"nrOfNormalTopUps"	U32	count	Decimal
OBJECT_ANALOG_VALUE:32	R	"nrOfEmergencyStops"	U32	count	Decimal
OBJECT_ANALOG_VALUE:33	R	"safetyValveActivations"	U32	count	Decimal
OBJECT_ANALOG_VALUE:34	R	"activationsVfc1"	U32	count	Decimal
OBJECT_ANALOG_VALUE:35	R	"activationsVfc2"	U32	count	Decimal
OBJECT_ANALOG_VALUE:36	R	"activationsVfc3"	U32	count	Decimal

Yhteystiedot

The Netherlands

hydronic flow control
+31 36 520 62 300
info@flamcogroup.com
www.flamcogroup.com

Belgium

hydronic flow control
+32 2 371 01 67
info@flamco.be

China

Flamco Heating Accessories
(Changshu) Ltd, Co.
+86 512 528 417 31
yecho@flamco.com.cn

Czech Republic

Flamco CZ s.r.o.
+420 284 00 10 81
info@meibes.cz

Denmark

Flamco Denmark
+45 44 94 02 07
info@flamco.dk

Estonia

Flamco Baltic
+372 568 838 38
info@flamco.ee

Finland

Flamco Finland
+358 10 320 99 90
info@flamco.fi

France

hydronic flow control
+33 4 78 78 16 00
info@flamco.fr

Germany

Meibes System-Technik GmbH
+49 342 927 130
info@meibes.com

Germany

Flamco GmbH
+49 2104 80006 20
info@flamco.de

Hungary

Flamco Kft
+36 23 880981
info@flamco.hu

Italy

Flamco Italy
+39 030 258 6005
flamco-italia@flamcogroup.com

Poland

Flamco Meibes Sp. z o.o.
+48 65 529 49 89
info@flamco.pl

Russian Federation

ООО „Майбес РУС“
+7 495 727 20 26
moscow@flamcogroup.ru

Slovakia

Flamco SK s.r.o.
+421 475 634 043
info@meibes.sk

Sweden

Flamco Sverige
+46 50 042 89 95
vvs@flamco.se

Switzerland

Flamco AG
+41 41 854 30 50
info@flamco.ch

United Arab Emirates

Flamco Middle East
+971 4 8819540
info@flamco-gulf.com

United Kingdom

Flamco Limited
+44 17 447 447 44
info@flamco.co.uk

Flamco B.V.
Fort Blauwkapel 1
1358 DB Almere
the Netherlands
+31 36 52 62 300
info@flamcogroup.com
www.flamcogroup.com

Copyright Flamco B.V., Almere, the Netherlands. Käyttöohjeen mitään osaa ei saa kopioida eikä julkistaa missään muodossa ilman erillistä lupaa ja lähteen mainintaa. Lueteltuja tietoja sovelletaan ainoastaan Flamco-tuotteisiin. Flamco B.V. ei ota minkäänlaista vastuuta teknisten tietojen virheellisestä käytöstä, soveltamisesta eikä tulkinnasta. Flamco B.V. pidättää oikeuden teknisiin muutoksiin.